



DITEK Corporation  
ONE DITEK CENTER  
1720 Starkey Road  
Largo, FL 33771

INSTALLATION

# INSTALL INSTRUCTIONS

## DTK-120SRD

This Surge Protective Device (SPD) is a high performance device, designed to provide protection for sensitive electronic loads connected to service panels, fire panels, or where the SPD is directly connected to the electronic device. Maximum protection will only be achieved if the SPD is properly installed. Please read and follow the installation instructions carefully.

**NOTICE:** This SPD should be installed by a qualified electrician in accordance with the National and Local Electrical Codes and the following instructions.

### APPLICATION

Surge suppression for hardwired series installations in or with complete equipment for 120 VAC single branch circuits.

Model DTK-120SRD has Dry Contacts for remote notification of surge protection status.

### INSTRUCTIONS:

**Caution:** Measure all voltages to insure applied voltage does not exceed the voltage rating of the unit. Improper installation voids the warranty.

**NOTE:** Suitable for use on a circuit capable of delivering not more than 10,000 rms symmetrical Amperes when protected by a circuit breaker rated 20A and minimum 120 Volts.

**Warning:** No Serviceable Parts-**Attention:** Aucune pièce remplaçable ou réparable

### MOUNTING

This device is intended to be mounted inside an end-product enclosure suitable for its use with safety cover mounted to the threaded lugs to prevent a shock hazard from accidental contact with live metal parts. Use the cover and nylon nuts provided.

### DTK-120SRD WIRING INSTRUCTIONS

1. Turn off the power at the circuit breaker or main before beginning installation.
2. Securely mount this unit in series between the supply wiring and the equipment to be protected.
3. Allow 3 feet of conductor length between this device and the protected equipment. This will allow the unit time to react.
4. Use minimum 12 AWG stranded wire for all hook ups.
5. Remove the top nut from the input, output and ground lugs. (Do not remove the lower lock nut)
6. Connect the ground (Green or Bare) supply and protected equipment wires to the ground lug using one of the supplied ring terminals, replace the nut and torque to 10 inch pounds.

**Ground Resistance Rule:** Max ground resistance is 25 Ohms, 5 Ohms or less is optimum.

This cannot be an assumed value and must be measured to assure proper grounding.

7. Connect the neutral (White) supply and protected equipment wires to their respective neutral lugs using 2 of the supplied ring terminals, replace the top nuts and torque to 10 inch pounds.
8. Connect the line (Black) supply and protected equipment wires to their respective line lugs using 2 of the supplied ring terminals, replace the top nuts and torque to 10 inch pounds.
9. Install the plastic cover placing it over the threads and fasten with the included nylon nuts until snug.
10. After all connections have been made and no hazards exist, restore power.
11. Verify that the LED is on signifying surge protection active, AC power present and ground OK.

### Conditions of Installation:

- a) An insulated grounding conductor that is identical in size and insulation material and thickness to the grounded and ungrounded circuit supply conductors, except that it is green with or without one or more yellow stripes, is to be installed as part of the circuit that supplies the filter. Reference should be made to Table 250-122 of the National Electrical Code regarding the appropriate size of the grounding conductor.
- b) The grounding conductor mentioned in item a is to be grounded to earth at the service equipment or other acceptable building earth ground such as the building frame in the case of a high-rise steel-frame structure.
- c) Any attachment-plug receptacles in the vicinity of the filter are to be of a grounding type, and the grounding conductors serving these receptacles are to be connected to earth ground at the service equipment or other acceptable building earth ground such as the building frame in the case of a high-rise steel-frame structure.
- d) Pressure terminal or pressure splicing connectors and soldering lugs used in the installation of the filter shall be identified as being suitable for the material of the conductors. Conductors of dissimilar metals shall not be intermixed in a terminal or splicing connector where physical contact occurs between dissimilar conductors unless the device is identified for the purpose and conditions of use.




# INSTALL INSTRUCTIONS


DTK-120SRD

## Illustrations Page



INSTALLATION

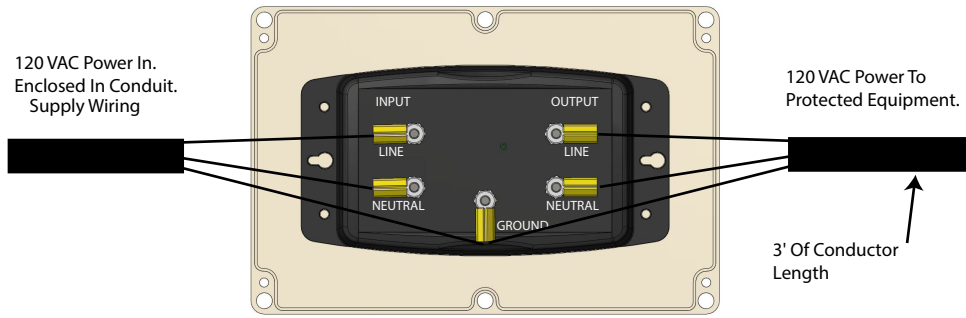


EXAMPLE REMOTE MONITORING USING FACP FOR NOTIFICATION

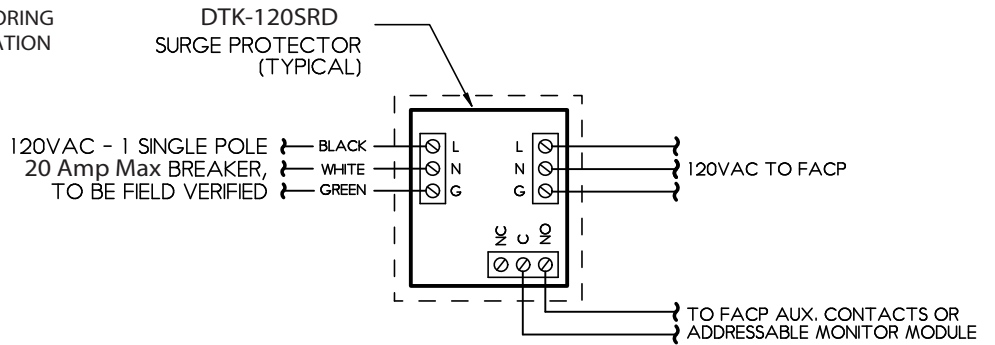

EXAMPLE MONITORING CIRCUIT

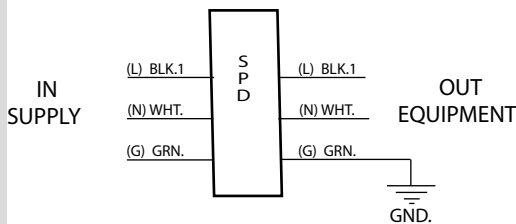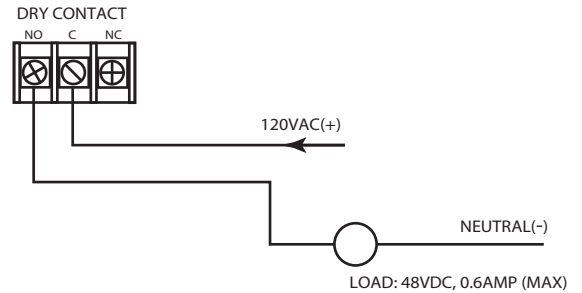

EXPECTED SYSTEM VOLTAGES			
120 VAC	L-N	L-G	N-G
VOLTAGES	120	120	0

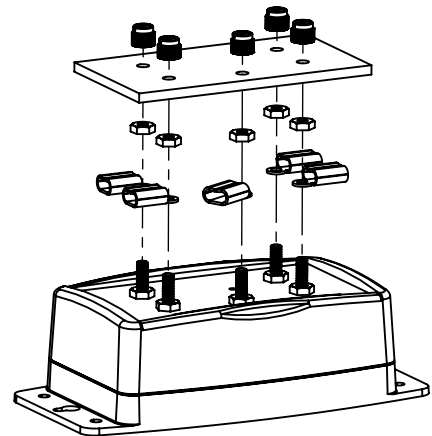

### DTK-120SRD DRY CONTACT OPERATION

The Dry Contacts are a SPDT Form 1C circuit rated 48VDC/0.6A, designed for low voltage or control signals only, and activate if the Phase leg loses its surge protection. The Dry Contacts are accessed by a three position terminal block (#28-16 AWG). The positions are marked Common (C), Normally Open (NO), and Normally Closed (NC). If the surge protection is lost, the contacts will reverse; Normally Open will close and Normally Closed will open. There is no change to the Common (C)