

DITEK Corporation ONE DITEK CENTER 1720 Starkey Road Largo, FL 33771

INSTALL INSTRUCTIONS

D50-120/2401

NOTICE: This SPD should be installed by a licensed contractor in accordance with all applicable National and Local Electrical Codes and the following instructions.

APPLICATION


Type 1 SPD for hardwired installation on a 120/240 VAC split phase electrical service.

INSTRUCTIONS:

Caution: Measure all voltages to verify applied voltage does not exceed the voltage rating of the unit. Reference the Expected System Voltages chart below. Improper installation voids the warranty.

NOTE: Suitable for use on a circuit capable of delivering not more than 100,000 rms symmetrical Amperes. Recommended circuit breaker size is 20 Amps. This SPD contains no serviceable parts.

- 1. Turn off the power at the main breaker or service disconnect before beginning installation.
- 2. Remove front cover from the electrical panel.
- 3. Determine the ideal mounting position of the SPD by orienting the unit as close as possible to the position of the circuit breaker selected for the SPD connection.
- 4. Remove a 3/4" knockout in the electrical panel or drill a 3/4" NPT hole in the electrical panel.
- 5. Feed all wires through the knockout hole in the panel and tighten the included 3/4" locknut to the SPD fitting.
- 6. Connect the Ground wire (Green) to the Ground bus inside of the panel.
- 7. Connect the Neutral wire (White) to the Neutral bus inside of the panel.
- 8. Connect the (2) Phase wires (Black) to the load side of the 2-pole circuit breaker.
- 9. If desired, secure the enclosure with appropriate anchors by using the mounting feet on the SPD enclosure.
- 10. After all connections have been made and no hazards exist, replace panel cover and restore power.

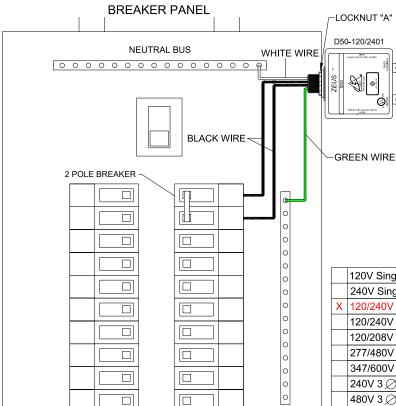

EXPECTED SYSTEM VOLTAGES

| | | L-L | HiL- G,N | L-G | L - N | N - G |
|---|-------------------|-----|----------|--------|-------|-------|
| | 120V Single Ø | N/A | N/A | 120 | 120 | 0 |
| | 240V Single Ø | N/A | N/A | 240 | 240 | 0 |
| Χ | 120/240V Split Ø | 240 | N/A | 120 | 120 | 0 |
| | 120/240V Hi Leg 🛆 | 240 | 240 | 120 | 120 | 0 |
| | 120/208V 3 Ø Wye | 208 | N/A | 120 | 120 | 0 |
| | 277/480V 3 Ø Wye | 480 | N/A | 277 | 277 | 0 |
| | 347/600V 3 Ø Wye | 600 | N/A | 347 | 347 | 0 |
| | 240V 3 Ø△ | 240 | N/A | 240Max | N/A | 0 |
| | 480V 3 Ø△ | 480 | N/A | 480Max | N/A | 0 |
| | 600V 3 Ø△ | 600 | N/A | 600Max | N/A | 0 |

DRAWN BY: BRIAN AYCOCK 12/13/23 APPROVED BY: MIKE MOLINARI 12/13/23 DITEK TECHNICAL SUPPORT 1-888-472-6100 www.diteksurgeprotection.com

GROUND BUS

DOC # INT-100121-001 PART NO. 191545 REV. 7